

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003498 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:02A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE.: POTABLE
 : RM 34 WATER FOUNTAIN PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003499 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:02A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 34 CLASS SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.5 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003500 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:02A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 34 REST ROOM SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.5 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003501 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:06A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 35 WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.5 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003502 CLIENT #: 551

NON STAT PROC

PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:06A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 35 CLASS SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	4.5 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003503 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:06A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 35 RESTROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003475 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:31A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE.: POTABLE
 : MAIN OFFICE RESTROOM SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003476 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:17A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RESTROOM NORTH SIDE OF KITCHEN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.0 ppb	0-15 ppb	SM 22 3113B

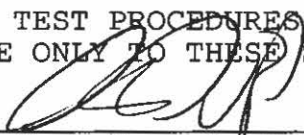
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003477 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:21A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: FACULTY ROOM SINK 37

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/15/20 LEAD (IMS) 1.6 ppb 0-15 ppb SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003478 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:16A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: KITCHEN 3 BAY RIGHT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003479 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:16A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: KITCHEN 3 BAY LEFT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 22 3113B

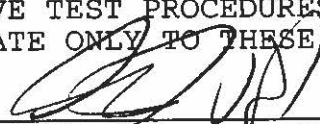
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003480 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:16A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: KITCHEN KETTLE FILLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003481 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:16A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE...: POTABLE
 : KITCHEN 1 BAY SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.1 ppb	0-15 ppb	SM 22 3113B

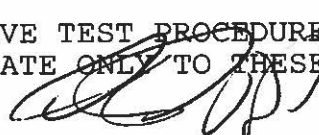
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003482 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:13A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: PHYS ED OFFICE SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	6.1 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003483 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:09A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE.: POTABLE
 : HEALTH OFFICE RESTROOM SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.1 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003484 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:09A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: HEALTH OFFICE HAND WASH SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.7 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003485 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:15A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
 : ROOM 2A SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 22 3113B

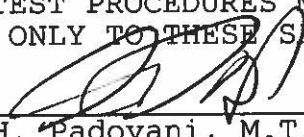
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003486 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:11A
DATE/TIME REC'D: 10/14/20 12:20A
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 30 CLASS SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	25.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

LEAD RESULT EXCEEDS THE MCL LEVEL OF 15ppb
MCL = MAXIMUM CONTAMINANT LEVEL; NOTIFIED CLIENT 10/19/20; LP

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003487 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:11A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE...: POTABLE
 : RM 30 RESTROOM SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	4.8 ppb	0-15 ppb	SM 22 3113B

COMMENTS:
Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003488 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:11A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 30 WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
-----------------	---------------	------	-----------	--------	----------------	--------

10/15/20			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 22 3113B
----------	--	--	------------	---------	----------	-------------


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003489 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/14/20 06:07A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/14/20 12:20P
ATTN: DAVID SPITTAL REPORT DATE: 10/19/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE...: POTABLE
 : RM 31 CLASSROOM SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES....: COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:
Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T.(ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003490 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:07A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 31 WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	3.4 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003491 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:07A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 31 RESTROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003492 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:02A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 32 RESTROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/15/20 LEAD (IMS) 3.6 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003493 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:04A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 32 CLASS SINK

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003494 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:03A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 32 WATER FOUNTAIN

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	1.8 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003495 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:00A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 33 WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003496 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:00A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 33 CLASS SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/15/20 LEAD (IMS) 9.7 ppb 0-15 ppb SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003497 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/14/20 06:00A
DATE/TIME REC'D: 10/14/20 12:20P
REPORT DATE: 10/19/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 33 RESTROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/15/20			LEAD (IMS)	2.1 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003555 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:30A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 22 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003556 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:30A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 22 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	6.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003557 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:30A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 22 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	4.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003558 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:27A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 21 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/22/20 LEAD (IMS) 1.3 ppb 0-15 ppb SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003559 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:27A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 21 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	2.7 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003560 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:27A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 21 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	3.8 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003561 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:25A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 20 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	5.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003562 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/20/20 06:25A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/20/20 10:05A
ATTN: DAVID SPITTAL REPORT DATE: 10/26/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL SAMPLE TYPE.: POTABLE
: 20 R.R. SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	3.0 ppb	0-15 ppb	SM 22 3113B

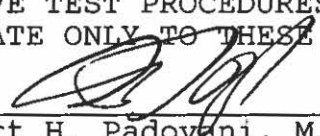
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003563 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:25A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 20 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20 C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	3.8 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10321

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003564 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:22A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 19 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	11.5 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003565 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:22A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 19 R.R. SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	6.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032:

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003566 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/20/20 06:22A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/20/20 10:05A
ATTN: DAVID SPITTAL REPORT DATE: 10/26/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL SAMPLE TYPE.: POTABLE
: 19 WTR FTN PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	4.8 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003579 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 05:58A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 1ST FLR GIRLS NEXT TO COPY LEFT SINK

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/23/20 LEAD (IMS) 5.9 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003580 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:01A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEM SCHOOL
: BOYS RM NEXT TO SRO LEFT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/23/20 LEAD (IMS) 18.5 ppb 0-15 ppb SM 22 3113B

COMMENTS:

LEAD RESULT EXCEEDS THE MCL LEVEL OF 15 ppb
MCL=MAXIMUM CONTAMINANT LEVEL;MARY BONDI NOTIFIED 10/26/20;RP


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003581 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 05:58A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: WTR FTN ACROSS FROM ELEVATOR

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/23/20 LEAD (IMS) 2.5 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003582 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:11A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 2A BOYS RT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003583 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 05:58A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: GIRLS RM NEXT TO COPY RM RIGHT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	9.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003584 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:01A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: BOYS ROOM NEXT TO SRO RIGHT SINK

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	14.7 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003585 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:03A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: R.R. SINK OUTSIDE LIBRARY

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003586 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:04A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: LIBRARY SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	7.1 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003587 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:43A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: RM 27 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	5.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003588 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:14A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: ROOM 2A STAFF BATHROOM

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	11.6 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003589 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:09A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: 2A WTR FTN RIGHT

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	3.6 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003590 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:09A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 2A WTR FTN LEFT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003567 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/20/20 06:35A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/20/20 10:05A
ATTN: DAVID SPITTAL REPORT DATE: 10/26/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL SAMPLE TYPE.: POTABLE
: RM26 SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	9.6 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003568 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:35A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 26 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	5.7 ppb	0-15 ppb	SM 22 3113B

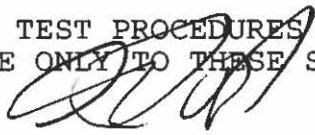
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003569 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:35A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 26 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032.

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003570 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:38A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/28/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 25 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	2.5 ppb	0-15 ppb	SM 22 3113B

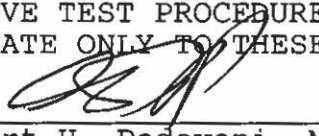
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032.

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003571 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:38A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 25 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003572 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:38A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEM SCHOOL
: RM 25 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/23/20 LEAD (IMS) 12.7 ppb 0-15 ppb SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003573 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/20/20 06:41A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/20/20 10:05A
ATTN: DAVID SPITTAL REPORT DATE: 10/26/20
PUTNAM VALLEY, NY 10579 PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL SAMPLE TYPE.: POTABLE
 : RM 24 SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES....: COLIFORM METH: MF

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	8.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
 (INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
 U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
 NATIONAL PRIMARY DRINKING WATER REGULATIONS
 VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
 Albert H. Padovani, M.T. (ASCP)
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003574 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:41A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 24 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	79 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

LEAD RESULT EXCEEDS THE MCL LEVEL OF 15 ppb
MCL=MIXIMUM CONTAMINANT LEVEL;NOTIFIED MARY BONDI 10/26/20;RP

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003575 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:41A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 24 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	10.2 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003576 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:33A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 23 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: MF

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	13.2 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003577 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:33A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 23 WTR FTN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/22/20			LEAD (IMS)	4.0 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 1032:

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003578 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:33A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: RM 23 R.R. SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	1.8 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003591 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:12A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: GIRLS ROOM 2A LEFT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003592 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:07A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: ROOM 17 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003593 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:07A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: BOYS 2A LEFT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003594 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:12A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: GIRLS 2A RIGHT SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	4.2 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003595 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:05A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: ROOM 7 SINK
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME END DATE/TIME FLAG PROCEDURE RESULT NORMAL - RANGE METHOD

10/23/20 LEAD (IMS) 19.0 ppb 0-15 ppb SM 22 3113B

COMMENTS:

LEAD RESULT EXCEEDS THE MCL LEVEL OF 15ppb
MCL=MAXIMUM CONTAMINANT LEVEL;NOTIFIED MARY BONDI 10/26/20; RP

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.


IMS IMS = IMMEDIATE METAL SAMPLE.

(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003596 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/20/20 06:09A
DATE/TIME REC'D: 10/20/20 10:05A
REPORT DATE: 10/26/20
PHONE: (914)-526-8900

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: 2A BOTTLE FILLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/23/20			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032:

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003656 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:50A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES 2ND FLOOR GIRLS SINK LEFT
COL'D BY: CAREY CLERICI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	4.2 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032:

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003657 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:50A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES 2ND FLOOR GIRLS SINK RIGHT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	3.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032:

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003658 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL DATE/TIME TAKEN: 10/24/20 10:01A
146 PEEKSKILL HOLLOW RD DATE/TIME REC'D: 10/26/20 11:40A
ATTN: DAVID SPITTAL REPORT DATE: 11/06/20
PUTNAM VALLEY, NY 10579 PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT SAMPLE TYPE...: POTABLE
 : ES 3RD FLOOR FACULTY SINK PRESERVATIVES: HNO3
COL'D BY: CAREY CLERICI TEMP RECEIVED: 20C NOT ON ICE
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	8.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
 A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003659 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:52A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES 2ND FLOOR WATER FOUNTAIN

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	5.5 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003660 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:54A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES 2ND FL BOYS RIGHT SINK
COL'D BY: CAREY CLERICI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10325

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003661 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:54A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES 2ND FLOOR BOY SINK LEFT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	2.3 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003662 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 10/24/20 09:47A
DATE/TIME REC'D: 10/26/20 11:40A
REPORT DATE: 11/06/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY SCHOOL DISTRICT
: ES ROOM 30 RE TEST

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/30/20			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 1032

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003753 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 11/04/20 06:31A
DATE/TIME REC'D: 11/04/20 11:45A
REPORT DATE: 11/09/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY ELEMENTRY SCHOOL
: ROOM 24 WATER FOUNTAIN RETEST

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/05/20			LEAD (IMS)	5.0 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NRK 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003754 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 11/04/20 06:26A
DATE/TIME REC'D: 11/04/20 11:45A
REPORT DATE: 11/09/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: ROOM 7 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/05/20			LEAD (IMS)	10.9 ppb	0-15 ppb	SM 22 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

NRR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.003755 CLIENT #: 551 NON STAT PROC PAGE: 1 of 1

PUTNAM VALLEY CENTRAL
146 PEEKSKILL HOLLOW RD
ATTN: DAVID SPITTAL
PUTNAM VALLEY, NY 10579

DATE/TIME TAKEN: 11/04/20 06:27A
DATE/TIME REC'D: 11/04/20 11:45A
REPORT DATE: 11/09/20
PHONE: (845)-526-7854

SAMPLING SITE: PUTNAM VALLEY ELEMENTARY SCHOOL
: BOYS ROOM NEW SRO LEFT SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 20C NOT ON ICE
COLIFORM METH: N/A

COL'D BY: CAREY CLERICI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/05/20			LEAD (IMS)	5.9 ppb	0-15 ppb	SM 22 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

NR 'NORMAL-RANGE' REFERENCE=
U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA); MAY 2009
NATIONAL PRIMARY DRINKING WATER REGULATIONS
VISIT: <https://www.epa.gov/ground-water-and-drinking-water/national-primary-drinking-water-regulation-table>

IMS IMS = IMMEDIATE METAL SAMPLE.
(INTERPRETATION: WATER SAMPLED AFTER SITTING UNDISTURBED
A MINIMUM OF 6 HOURS OR OVERNIGHT)

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10320